

(GOVT. RECOGNISED LABORATORIES)



MET-CHEM LABORATORIES

"CHINTAMANI" PLOT NO. 10, PARSHURAMNAGAR SOCIETY, SAYAJI GUNJ, VADODARA-20. • PH.: (0265) 2361314/19 Mo.:9427611654 E-mail : sgirish13@gmail.com • Web site : www.met-chemlaboratories.com

Multi Kilfire P. Ltd.
4, Amin Industrial Estate,
Gorwa Road,
Vadodara - 39

TEST CERTIFICATE
Report No : 1390
Date : 20/02/2016


(THIS SAMPLE/S WAS/WERE NOT DRAWN BY US)

Test Results :

: KF-600 FIRE RETARDANT COATING COMPOUND FOR ELECTRICAL CABLE:

CHEMICAL RESISTANCE TEST :

Sr.No.	Test	Result
1.	5 % HCL	No Effect
2.	5 % H2SO4	No Effect
3.	5 % HNO3	No Effect
4.	5 % NaOH	No Effect
5.	5 % H3PO4	No Effect
6.	5 % KOH	No Effect
7.	5 % Methanol	No Effect
8.	Kerosene	No Effect

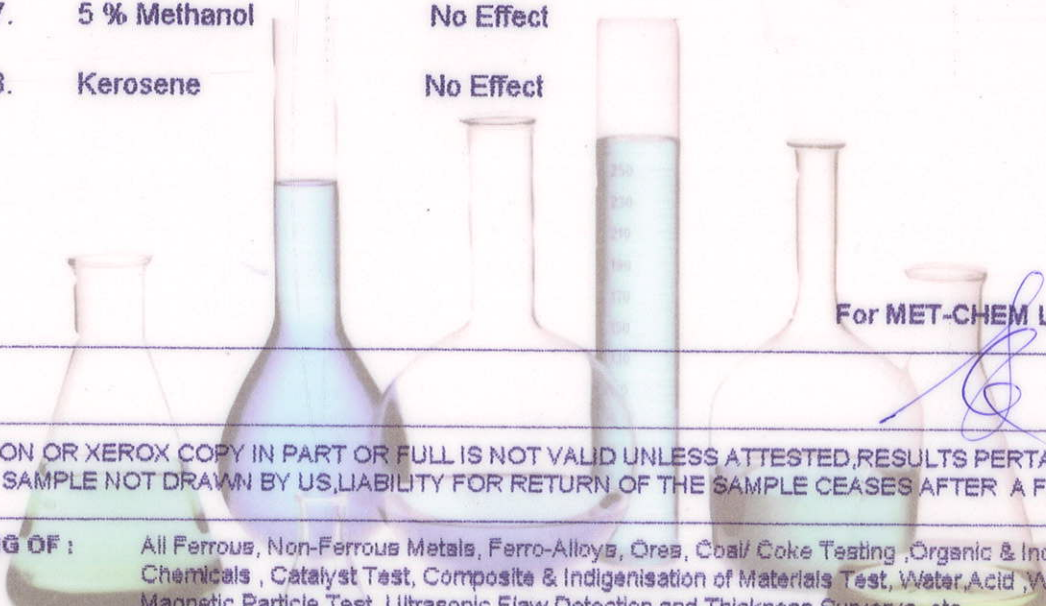

For MET-CHEM Laboratories
[Signature]

ANY REPRODUCTION OR XEROX COPY IN PART OR FULL IS NOT VALID UNLESS ATTESTED, RESULTS PERTAIN TO THE SAMPLE (S) ONLY. SAMPLE NOT DRAWN BY US, LIABILITY FOR RETURN OF THE SAMPLE CEASES AFTER A FORTNIGHT.

CHEMICAL TESTING OF : All Ferrous, Non-Ferrous Metals, Ferro-Alloys, Ores, Coal/ Coke Testing, Organic & Inorganic Chemicals, Catalyst Test, Composite & Indigenisation of Materials Test, Water, Acid, Wood testing.

NDT TESTING : Magnetic Particle Test, Ultrasonic Flaw Detection and Thickness Surverya, etc.

PHYSICAL TEST : Physical (Tensile / Impact / Hardness, Micro / Macro Etc.) Sieve Analysis for various Materials etc.

OTHER TEST : Any type of Third Party Inspection, Corrosion tests, Residual Life Assesment etc.

