

(GOVT. RECOGNISED LABORATORIES)



MET-CHEM LABORATORIES

"CHINTAMANI" PLOT NO. 10, PARSHURAMNAGAR SOCIETY, SAYAJI GUNJ, VADODARA-20. • PH.: (0265) 2361314/19 Mo.:9427611654 E-mail : sgirish13@gmail.com • Web site : www.met-chemlaboratories.com

Multi Kilfire P. Ltd.
4, Amin Industrial Estate,
Gorwa Road,
Vadodara - 16


TEST CERTIFICATE
Report No : 1403
Date : 21/02/2016

(THIS SAMPLE/S WAS/WERE NOT DRAWN BY US)

Test Results :

GAS GENERATION TEST

- 1. Sample Description : KF-600 Fire retardant compound Sample
2mm thick, width 10 mm, Length 80mm.
- 2. Test Description : Amount of Halogen Acid Gas Generating
from on ignition.
- 3. Required Standard : IEC - 754 Pt.-1.
- 4. Result Generation : There was no any Halogen Acid Gas
& Hence test found Satisfactory.

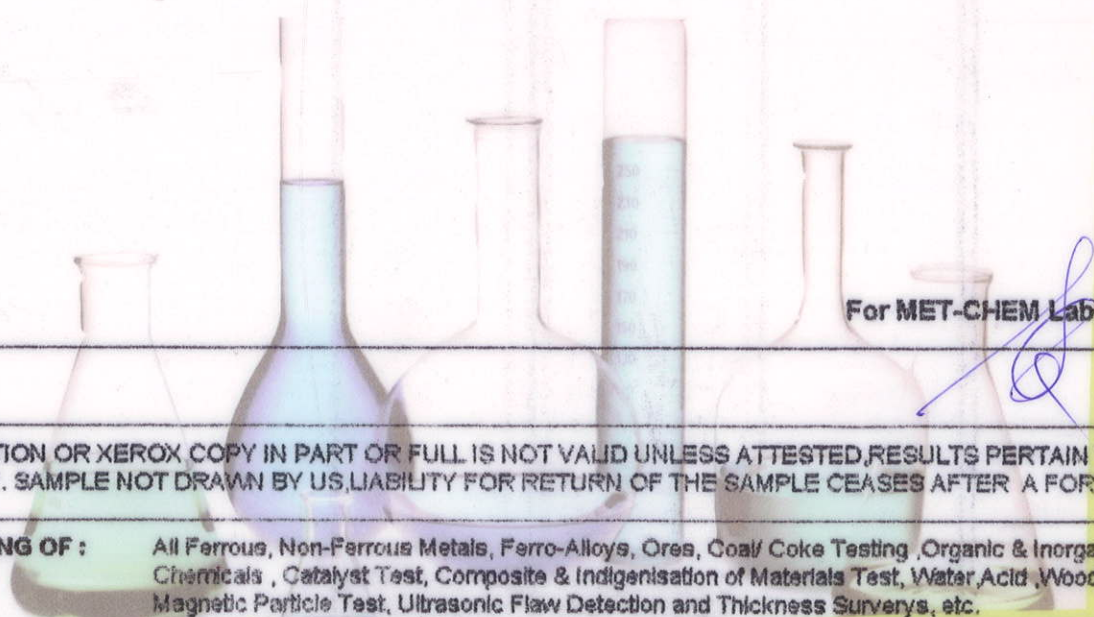

For MET-CHEM Laboratories

ANY REPRODUCTION OR XEROX COPY IN PART OR FULL IS NOT VALID UNLESS ATTESTED RESULTS PERTAIN TO THE SAMPLE (S) ONLY. SAMPLE NOT DRAWN BY US, LIABILITY FOR RETURN OF THE SAMPLE CEASES AFTER A FORTNIGHT.

CHEMICAL TESTING OF : All Ferrous, Non-Ferrous Metals, Ferro-Alloys, Ores, Coal/ Coke Testing, Organic & Inorganic Chemicals, Catalyst Test, Composite & Indigenisation of Materials Test, Water, Acid, Wood testing, Magnetic Particle Test, Ultrasonic Flaw Detection and Thickness Surverys, etc.

NDT TESTING : Physical (Tensile / Impact / Hardness, Micro / Macro Etc.) Sieve Analysis for various Materials etc.

PHYSICAL TEST : Any type of Third Party Inspection, Corrosion tests, Residual Life Assesment etc.

OTHER TEST :

